


Temecula Farmers Market
41952 6th Street, Temecula, CA 92590

Scope of Work: 1x Delta50kw (208V)


1. Obtain all Permits
2. Remove all BTC Charger
3. Remove all AC Conductors
4. Reuse existing AC Breaker
5. Install Delta50 (208V)
 - Pull-In new AC Conductors (3x 3/0 [THWN-2], 1x #6 [THWN-2])
6. Site Testing & Commissioning
7. Install new Signs and any Stencils
8. Package and send all BTC Chargers to EVgo
9. Revised Drawings

Overview

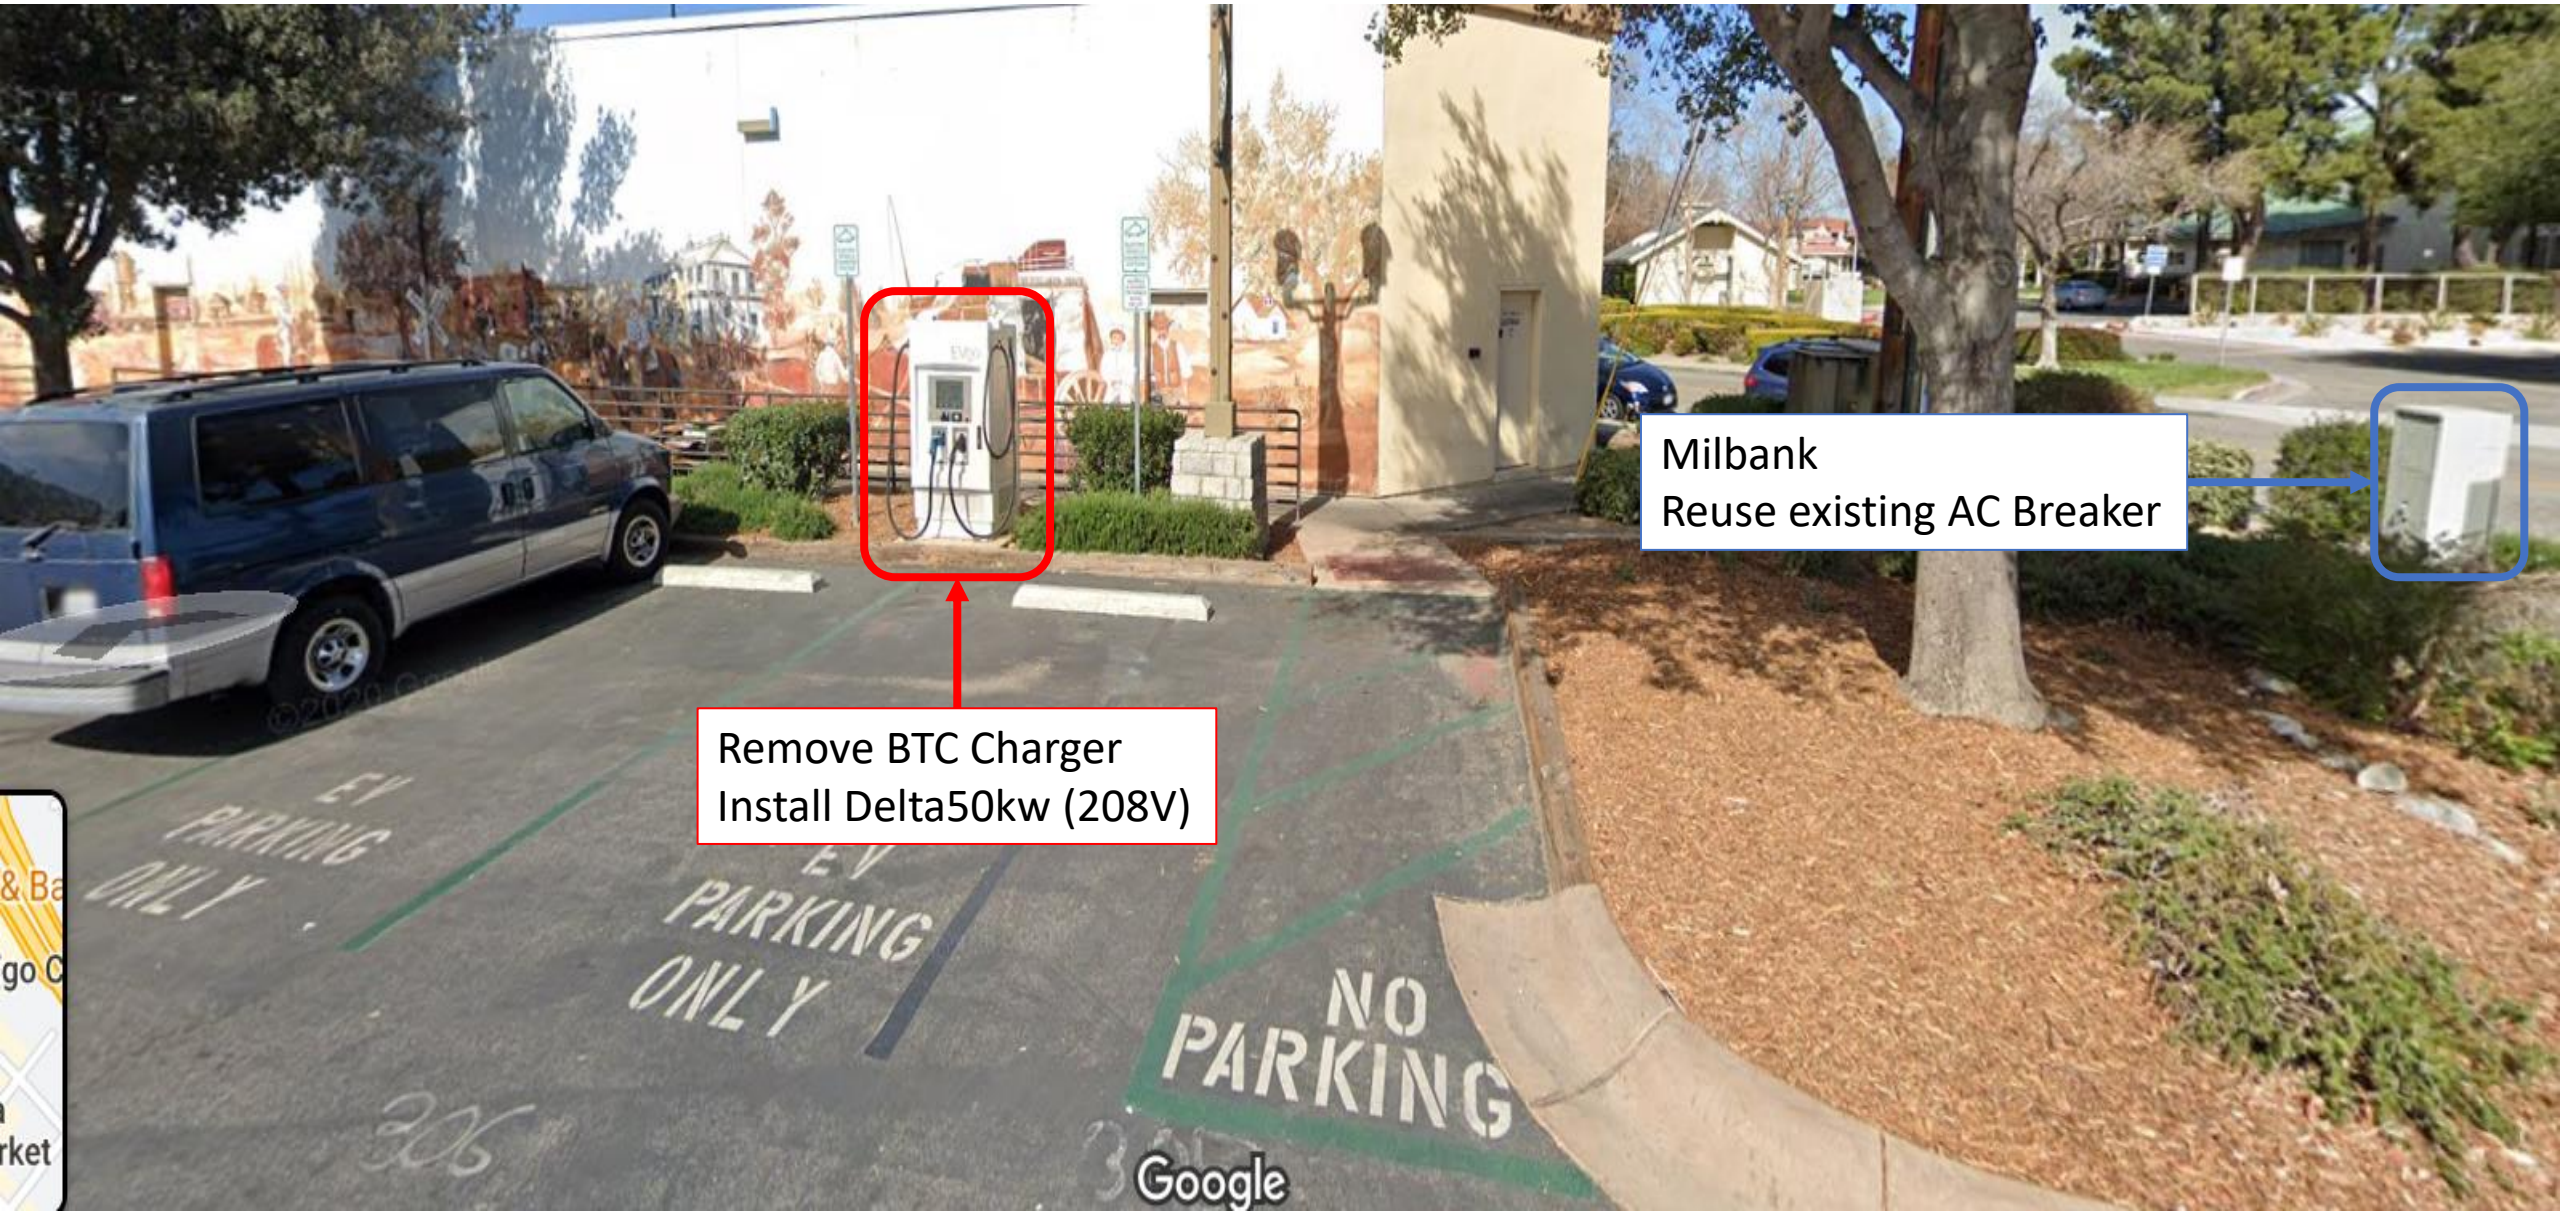


Remove BTC Charger
Install Delta50kw (208V)

Milbank
Reuse existing AC Breaker



Single Line Drawing

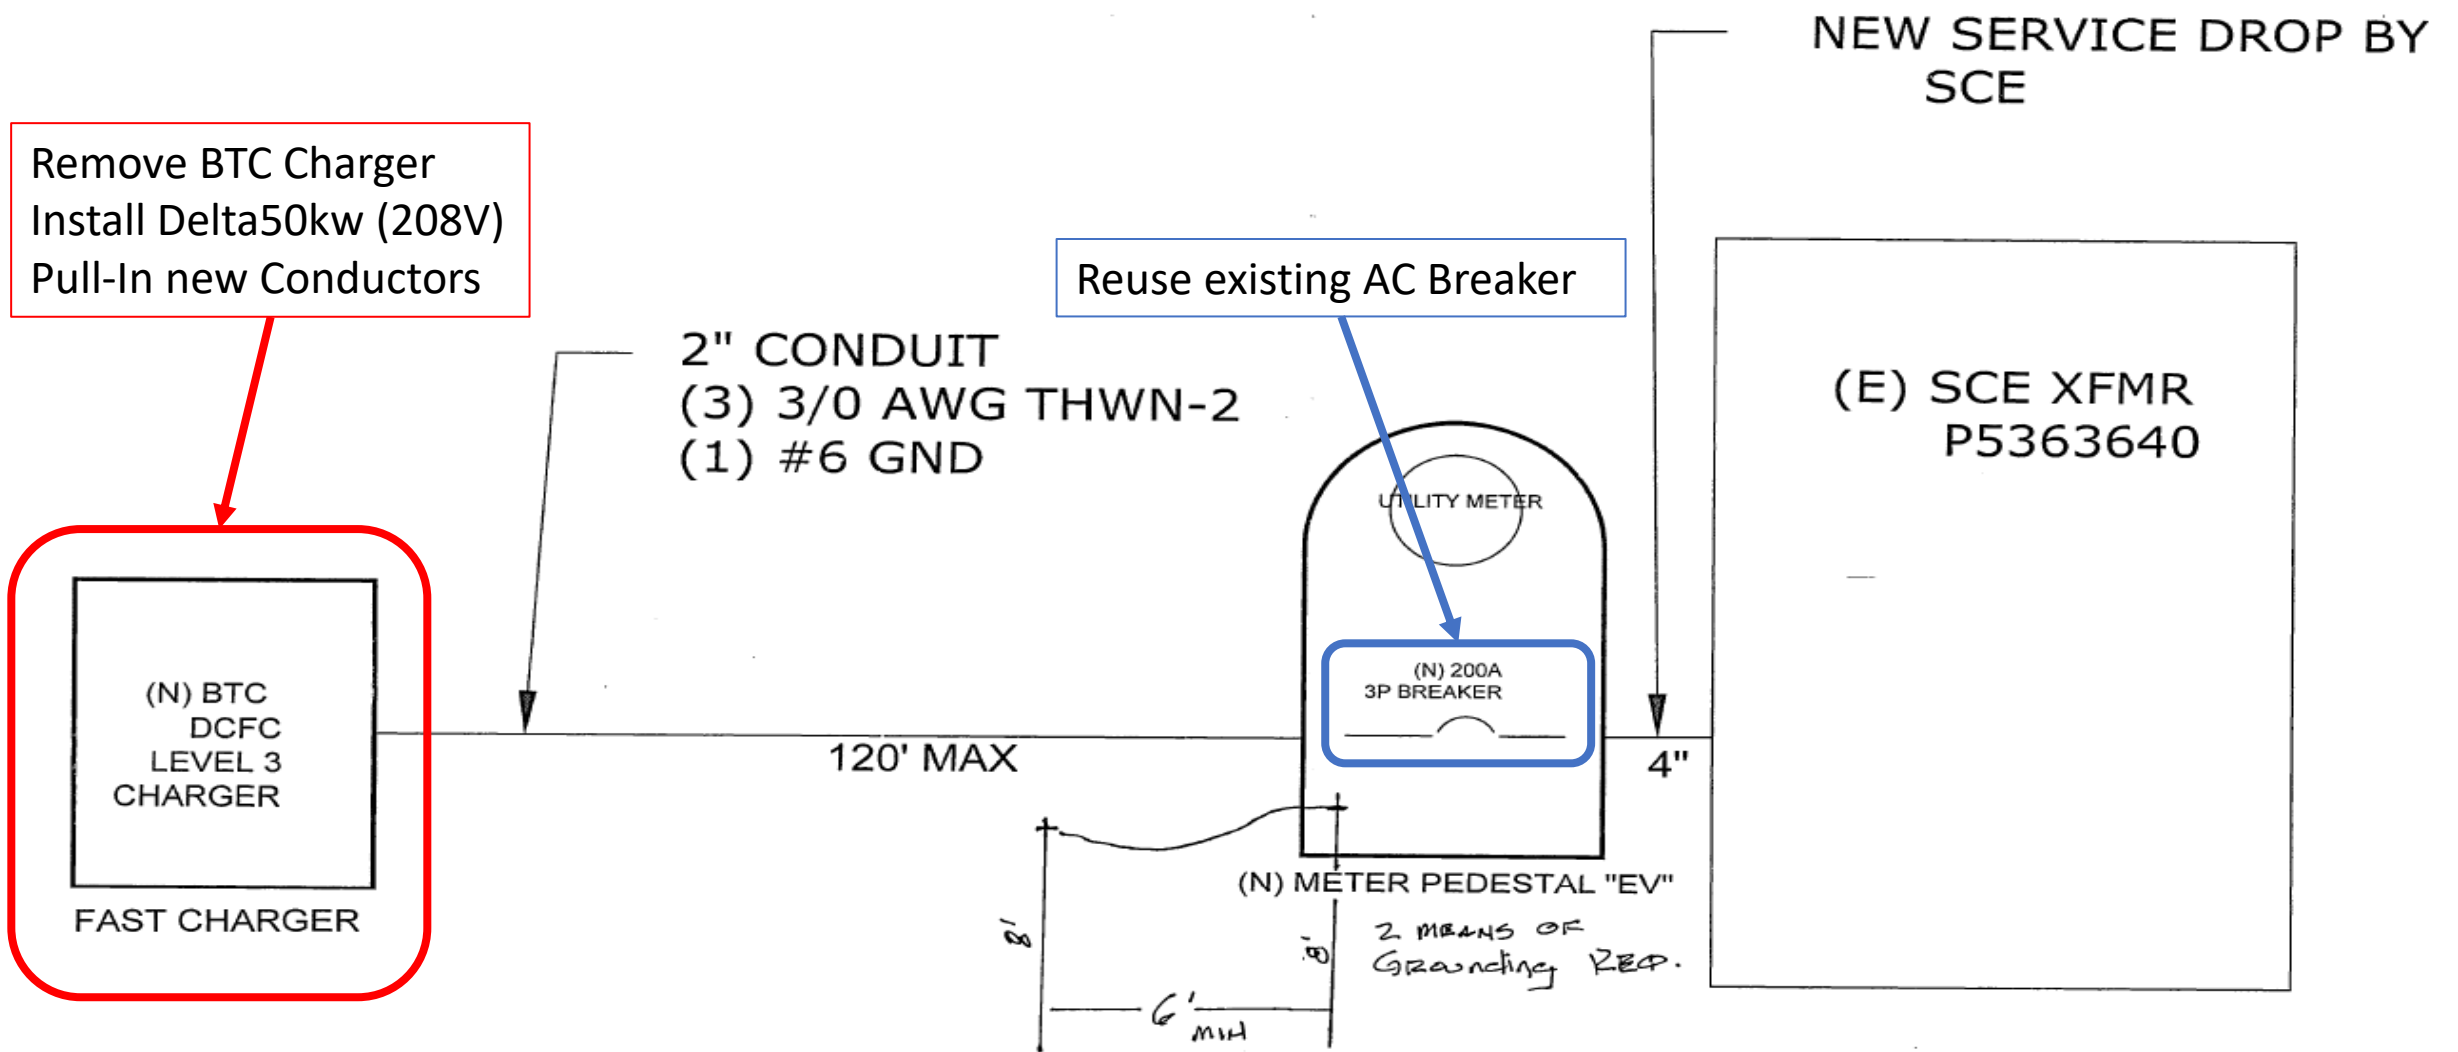

EV CHARGING STATION - SINGLE LINE

SCALE: NTS

A

Charger Foundation

Ground mounting

1. The mounting site must have a minimum width of 1900 mm and a depth of 1370 mm to ensure adequate ventilation and maintenance space.
 - Charger size W x D x H: 800 x 590 x 1500 mm.
 - Leave a minimum of 560 mm in front of the charger such that the front door can be opened.
 - Leave a minimum of 550 mm on both sides of the panels such that they can be opened.
 - Leave a minimum of 220 mm in the back of the charger such that the back panel can be opened.

